

NA30

FEEDER PROTECTION RELAY

THE BASIC SOLUTION FOR FEEDERS AND TRANSFORMERS PROTECTION WITH THERMAL IMAGE AND GROUND DIRECTIONAL ELEMENTS




— Application

The relay type NA30 can be used in radial networks as feeder or power transformer protection:

- On long feeders in ungrounded or Petersen coil and/or high resistance grounded systems.
- On the BT side of parallel connect transformers that are protected with differential element with any ground-ed systems.
- As ground fault protection of parallel connected generators or generator-transformer unit on the same Busbar.

The relay complies with CEI 0-16 requirements.

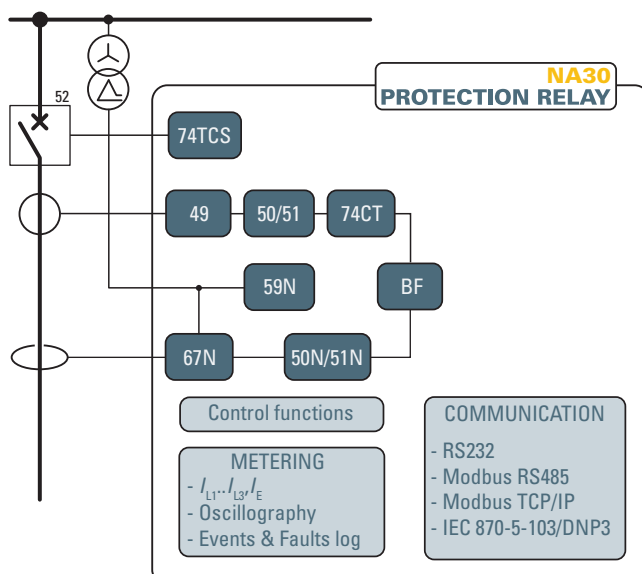

- Protective & control functions

49	Thermal image (for lines and transformers)
50/51	Phase overcurrent
50N/51N	Residual overcurrent
59N	Residual overvoltage
67N	Ground directional overcurrent
BF	Circuit breaker failure
74CT	CTs monitoring
74TCS	Trip circuit supervision

— Firmware updating

The use of flash memory units allows on-site firmware updating.

— Two set point profiles (A,B)

Two independent groups of settings are provided. Switching from profiles may be operated by means of MMI, binary input and communication.

— Measuring inputs

- Three phase current inputs and one residual current input, with nominal currents independently selectable at 1 A or 5 A through DIP-switches.
- One residual voltage input, with programmable nominal voltage within range 50...130 V ($U_{ER}=100$ V).

— Construction

According to the hardware configurations, the NA30 protection relay can be shipped in various case styles depending on the required mounting options (flush, projecting mounting, rack or with separate operator panel).

— Binary inputs

Five binary inputs are available with programmable active state (active-ON/active-OFF) and programmable timer (active to OFF/ON or ON/OFF transitions).

Several presettable functions can be associated to each input.

— Modular design

In order to extend I/O capability, the NA30 hardware can be customized through external auxiliary modules:

- MRI - Output relays and LEDs
- MID16 - Binary inputs
- MCI - 4...20 mA converter
- MPT - Pt100 probe inputs.



— Blocking input/outputs

One output blocking circuit and one input blocking circuit are provided.

The output blocking circuits of one or several Pro_N relays, shunted together, must be connected to the input blocking circuit of the protection relay, which is installed upstream in the electric plant. The output circuit works as a simple contact, whose condition is detected by the input circuit of the upstream protection relay.

Use of suitable pilot wire to fiber optic converters (BFO) allows to perform fast and reliable accelerated logic selectivity on radial and closed ring networks.

— Output relays

Six output relays are available (two changeover, three make and one break contacts); each relay may be individually programmed as normal state (normally energized, de-energized or pulse) and reset mode (manual or automatic).

A programmable timer is provided for each relay (minimum pulse width). The user may program the function of each relay according to a matrix (tripping matrix) structure.

— MMI (Man Machine Interface)

The user interface comprises a membrane keyboard, a backlight LCD alphanumeric display and eight LEDs.

The green ON LED indicates auxiliary power supply and self diagnostics, two LEDs are dedicated to the Start and Trip (yellow for Start, red for Trip) and five red LEDs are user assignable.



— Communication

Multiple communication interfaces are implemented:

- One RS232 local communication front-end interface for communication with ThySetter setup software.
- Two back-end interfaces for communication with remote monitoring and control systems by:
 - RS485 port - ModBus® RTU, IEC 60870-5-103 or DNP3 protocol,
 - Ethernet port (RJ45 or optical fiber) - ModBus/TCP protocol.

— Programming and settings


All relay programming and adjustment operations may be performed through MMI (Keyboard and display) or using a Personal Computer with the aid of the ThySetter software.

The same PC setup software is required to set, monitor and configure all Pro_N devices.

Full access to the available data is provided:

- Read status and measures.
- Read/edit settings (on-line or off-line edit).

Two session level (User or Administrator) with password for sensible data access are provided.

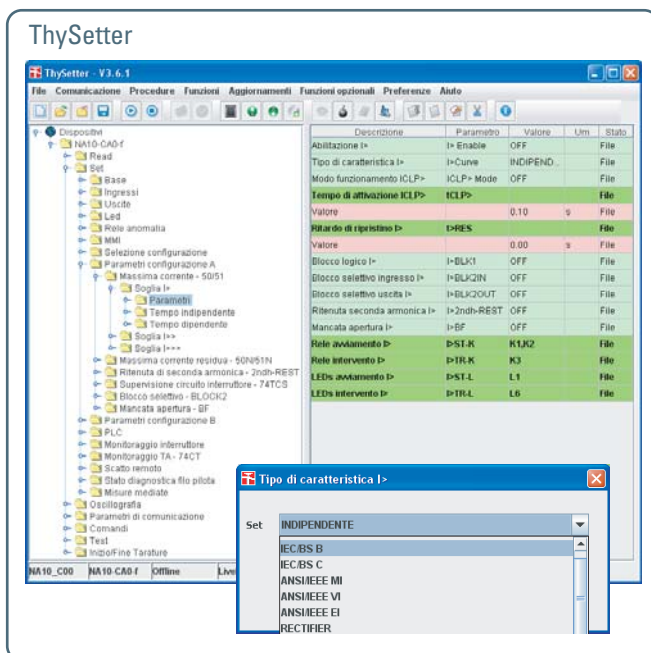

— **Control and monitoring**

Several predefined functions are implemented:

- Activation of two set point profiles
- Phase CTs monitoring (74CT)
- Logic selectivity
- Cold load pickup (CLP) with block or setting change
- Trip circuit supervision (74TCS)
- Second harmonic restraint (inrush)
- Remote tripping
- Synchronization
- Circuit Breaker commands and diagnostic

User defined logic may be customized according to IEC 61131-3 standard protocol (PLC).

Circuit Breaker commands and diagnostic

Several diagnostic, monitoring and control functions are provided:

- Health thresholds can be set; when the accumulated duty (ΣI or ΣI^2t), the number of operations or the opening time exceeds the threshold an alarm is activated.
- Breaker failure (BF); breaker status is monitored by means 52a-52b and/or through line current measurements.
- Trip Circuit Supervision (74TCS).
- Breaker control; opening and closing commands can be carried out locally or remotely.

Cold Load Pickup (CLP)

Cold load pickup element prevents unwanted tripping in case of temporary overcurrents produced when a feeder is being connected after an extended outage (e.g. motor starting).

Two different operating modes are provided:

- Each protective element can be blocked for a adjustable time.
- Each threshold can be increased for a programmable time.

Second harmonic restraint

To prevent unwanted tripping of the protective functions on transformer inrush current, the protective elements can be blocked when the ratio between the second harmonic current and the relative fundamental current is larger than a user programmable threshold.

The function can be programmed to switch an output relay so as to cause a blocking protection relays lacking in second harmonic restraint.

Logic selectivity

With the aim of providing a fast selective protection system some protective functions may be blocked (pilot wire accelerated logic). To guarantee maximum fail-safety, the relay performs a run time monitoring for pilot wire continuity and pilot wire shorting. Exactly the output blocking circuit periodically produces a pulse, having a small enough width in order to be ignored as an effective blocking signal by the input blocking circuit of the upstream protection, but suitable to prove the continuity of the pilot wire.

Furthermore a permanent activation (or better, with a duration longer than a preset time) of the blocking signal is identified, as a warning for a possible short circuit in the pilot wire or in the output circuit of the downstream protection.

— **Self diagnostics**

All hardware and software functions are repeatedly checked and any anomalies reported via display messages, communication interfaces, LEDs and output relays.

Anomalies may refer to:

- Hw faults (auxiliary power supply, output relay coil interruptions, MMI board...).
- Sw faults (boot and run time tests for data base, EEPROM memory checksum failure, data BUS,...).
- Pilot wire faults (break or short in the wire).
- Circuit breaker faults.

— **Metering**

NA30 provides metering values for phase and residual currents, residual voltage, making them available for reading on a display or to communication interfaces.

Input signals are sampled 24 times per period and the RMS value of the fundamental component is measured using the DFT (Discrete Fourier Transform) algorithm and digital filtering.

With DFT the RMS value of 2nd, 3rd, 4th and 5th harmonic of phase current are also measured.

On the base of the direct measurements, several calculated (min, max, average,...), phase, sequence measures are processed.

Measures can be displayed with reference to nominal values or directly expressed in amperes and volts.

— **Event storage**

Several useful data are stored for diagnostic purpose; the events are stored into a non volatile memory.

They are graded from the newest to the older after the "Events reading" command (ThySetter) is issued:

- Sequence of Event Recorder (SER).
The event recorder runs continuously capturing in circular mode the last three hundred events upon trigger of binary input/output.
- Sequence of Fault Recorder (SFR).
The fault recorder runs continuously capturing in circular mode the last twenty faults upon trigger of binary input/output and/or element pickup (start-trip).
- Settings recording
Following some setting changes the last eight changes are recorded in circular mode (Data Logger CEI 0-16)
- Trip counters.


— **Digital Fault Recorder (Oscillography)**

Upon trigger of tripping/starting of each function or external signals, the relay records in COMTRADE format:

- Oscillography with instantaneous values for transient analysis.
- RMS values for long time periods analysis.
- Logic states (binary inputs and output relays).

Note - A license for Digital Fault Recorder function is required, for purchase procedure please contact Thytronic.

The records are stored in nonvolatile memory

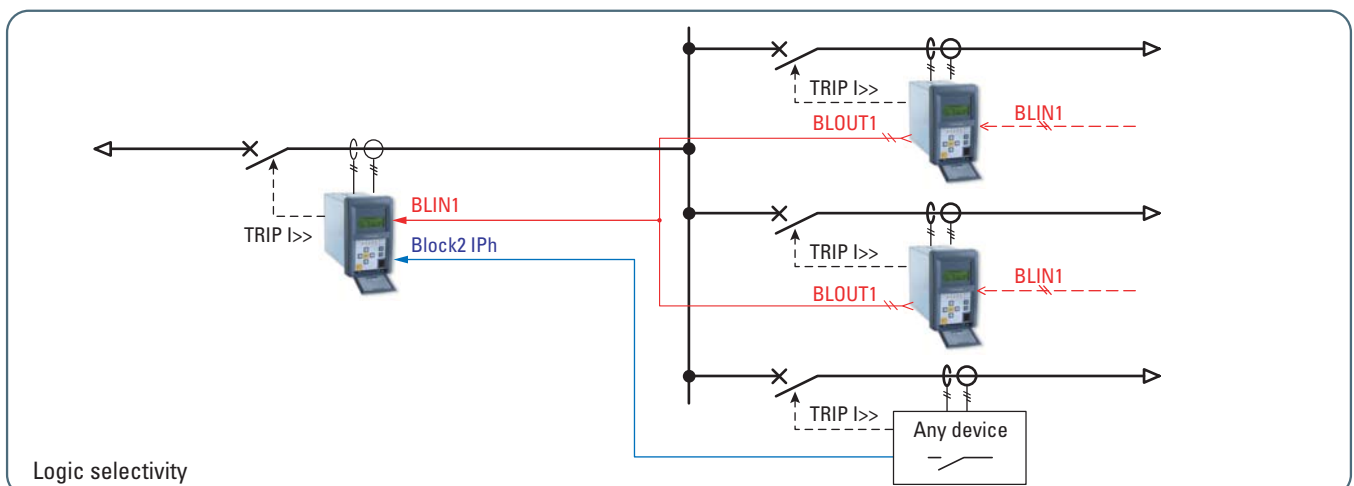

Logic selectivity

SPECIFICATIONS

GENERAL

— Mechanical data	
Mounting:	flush, projecting, rack or separated operator panel
Mass (flush mounting case)	2.0 kg
— Insulation tests	
Reference standards	EN 60255-5
High voltage test 50Hz	2 kV 60 s
Impulse voltage withstand (1.2/50 μ s)	5 kV
Insulation resistance	>100 M Ω
— Voltage dip and interruption	
Reference standards	EN 61000-4-29
— EMC tests for interference immunity	
1 MHz damped oscillatory wave	EN 60255-22-1 1 kV-2.5 kV
Electrostatic discharge	EN 60255-22-2 8 kV
Fast transient burst (5/50 ns)	EN 60255-22-4 4 kV
Conducted radio-frequency fields	EN 60255-22-6 10 V
Radiated radio-frequency fields	EN 60255-4-3 10 V/m
High energy pulse	EN 61000-4-5 2 kV
Magnetic field 50 Hz	EN 61000-4-8 1 kA/m
Damped oscillatory wave	EN 61000-4-12 2.5 kV
Ring wave	EN 61000-4-12 2 kV
Conducted common mode (0...150 kHz)	EN 61000-4-16 10 V
— Emission	
Reference standards	EN 61000-6-4 (ex EN 50081-2)
Conducted emission 0.15...30 MHz	Class A
Radiated emission 30...1000 MHz	Class A
— Climatic tests	
Reference standards	IEC 60068-x, ENEL R CLI 01, CEI 50
— Mechanical tests	
Reference standards	EN 60255-21-1, 21-2, 21-3
— Safety requirements	
Reference standards	EN 61010-1
Pollution degree	3
Reference voltage	250 V
Overvoltage	III
Pulse voltage	5 kV
Reference standards	EN 60529
Protection degree:	
• Front side	IP52
• Rear side, connection terminals	IP20
— Environmental conditions	
Ambient temperature	-25...+70 °C
Storage temperature	-40...+85 °C
Relative humidity	10...95 %
Atmospheric pressure	70...110 kPa
— Certifications	
Product standard for measuring relays	EN 50263
CE conformity	
• EMC Directive	89/336/EEC
• Low Voltage Directive	73/23/EEC
Type tests	IEC 60255-6

COMMUNICATION INTERFACES

Local PC RS232	19200 bps
Network:	
• RS485	1200...57600 bps
• Ethernet 100BaseT	100 Mbps
Protocol	ModBus® RTU/IEC 60870-5-103/DNP3, TCP/IP

INPUT CIRCUITS

— Auxiliary power supply Uaux	
Nominal value (range)	24...48 Vac/dc, 115...230 Vac/110...220 Vdc
Operative range (each one of the above nominal values)	19...60 Vac/dc 85...265 Vac/75...300 Vdc
<i>Power consumption:</i>	
• Maximum (energized relays, Ethernet TX)	10 W (20 VA)
• Maximum (energized relays, Ethernet FX)	15 W (25 VA)
— Phase current inputs	
Nominal current I_n	1 A or 5 A selectable by DIP Switches
Permanent overload	25 A
Thermal overload (1s)	500 A
Rated consumption (for any phase)	≤ 0.002 VA ($I_n = 1$ A) ≤ 0.04 VA ($I_n = 5$ A)
— Residual current input	
Nominal current I_{En}	1 A or 5 A selectable by DIP Switch
Permanent overload	25 A
Thermal overload (1s)	500 A
Rated consumption	≤ 0.006 VA ($I_{En} = 1$ A), ≤ 0.012 VA ($I_{En} = 5$ A)
— Residual voltage input	
Reference voltage U_{ER}	100 V
Nominal voltage U_{En}	50...130 V adjustable via sw
Permanent overload	1.3 U_{ER}
1s overload	2 U_{ER}
Rated consumption	≤ 0.5 VA
— Binary inputs	
Quantity	5
Type	dry inputs
Max permissible voltage	19...265 Vac/19...300 Vdc
Max consumption, energized	3 mA
— Block input (Logic selectivity)	
Quantity	1
Type	polarized wet input (powered by internal isolated supply)
Max consumption, energized	5 mA

OUTPUT CIRCUITS

— Output relays K1...K6	
Quantity	6
• Type of contacts K1, K2	changeover (SPDT, type C)
• Type of contacts K3, K4, K5	make (SPST-NO, type A)
• Type of contacts K6	break (SPST-NC, type B)
Nominal current	8 A
Nominal voltage/max switching voltage	250 Vac/400 Vac
<i>Breaking capacity:</i>	
• Direct current (L/R = 40 ms)	50 W
• Alternating current ($\lambda = 0,4$)	1250 VA
Make	1000 W/VA
Short duration current (0,5 s)	30 A
— Block output (Logic selectivity)	
Quantity	1
Type	optocoupler
— LEDs	
Quantity	8
• ON/fail (green)	1
• Start (yellow)	1
• Trip (red)	1
• Allocatable (red)	5

GENERAL SETTINGS

— Rated values	
Relay nominal frequency (f_n)	50, 60 Hz
Relay phase nominal current (I_n)	1 A, 5 A
Phase CT nominal primary current (I_{np})	1 A...10 kA
Relay residual nominal current (I_{En})	1 A, 5 A

Residual CT nominal primary current (I_{Enp})	1 A...10 kA
Relay residual nominal voltage (U_{En})	50...130 V
Residual primary nominal voltage (phase-to-phase) - $\sqrt{3} (U_{Enp})$	50 V...500 kV

Binary input timers

ON delay time (IN1 t_{ON} , IN2 t_{ON} ...IN5 t_{ON})	0.00...100.0 s
OFF delay time (IN1 t_{OFF} , IN2 t_{OFF} ...IN5 t_{OFF})	0.00...100.0 s
Logic	Active-ON/Active-OFF

Relay output timers

Minimum pulse width (t_{TR})	0.000...0.500 s
----------------------------------	-----------------

PROTECTIVE FUNCTIONS

Base current I_B

Base current (I_B)	0.10...2.50 I_n
------------------------	-------------------

Thermal protection with RTD thermometric probes - 26

Alarm

- Alarm threshold θ_{ALx} (x=1...8) 0...200 °C
- Operating time $t_{\theta ALx}$ (x=1...8) 0...100 s

Trip

- Trip threshold $\theta_{>x}$ (x=1...8) 0...200 °C
- Operating time $t_{\theta >x}$ (x=1...8) 0...100 s

Note: The element becomes available when the MPT module is enabled and connected to Thybus

Thermal image - 49

Common configuration:

- Initial thermal image $\Delta\theta_{IN}$ (Dth_{IN}) 0.0...1.0 $\Delta\theta_B$
- Reduction factor at inrush (K_{INR}) 1.0...3.0
- Thermal time constant τ (T) 1...200 min
- DthIN Activation time (t_{dthCLP}) 0.00...100.0 s

DthAL1 Element

- 49 First alarm threshold $\Delta\theta_{AL1}$ (Dth_{AL1}) 0.3...1.0 $\Delta\theta_B$

DthAL2 Element

- 49 Second alarm threshold $\Delta\theta_{AL2}$ (Dth_{AL2}) 0.5...1.2 $\Delta\theta_B$

Dth> Element

- 49 Trip threshold $\Delta\theta$ ($Dth>$) 1.100...1.300 $\Delta\theta_B$

Phase overcurrent - 50/51

I> Element

- I> Curve type (I>Curve) DEFINITE
IEC/BS A, B, C, ANSI/IEEE MI, VI, EI, RECTIFIER, I²t or EM
- $I_{CLP>}$ Activation time ($t_{CLP>}$) 0.00...100.0 s
- I> Reset time delay ($t_{>RES}$) 0.00...100.0 s

Definite time

- 50/51 First threshold definite time (I>def) 0.100...40.0 I_n
- I>def within CLP ($I_{CLP>def}$) 0.100...40.0 I_n
- I>def Operating time ($t_{>def}$) 0.04...200 s

Inverse time

- 50/51 First threshold inverse time (I>inv) 0.100...20.00 I_n
- I>inv within CLP ($I_{CLP>inv}$) 0.100...20.00 I_n
- I>inv Operating time ($t_{>inv}$) 0.02...60.0 s

I>> Element

- Type characteristic DEFINITE or I²t
- $I_{CLP>>}$ Activation time ($t_{CLP>>}$) 0.00...100.0 s
- I>> Reset time delay ($t_{>>RES}$) 0.00...100.0 s

Definite time

- 50/51 Second threshold definite time (I>>def) 0.100...40.0 I_n
- I>>def within CLP ($I_{CLP>>def}$) 0.100...40.0 I_n
- I>>def Operating time ($t_{>>def}$) 0.03...10.00 s

Inverse time

- 50/51 Second threshold inverse time (I>>inv) 0.100...20.00 I_n
- I>>inv within CLP ($I_{CLP>>inv}$) 0.100...20.00 I_n
- I>>inv Operating time ($t_{>>inv}$) 0.02...10.00 s

I>>> Element

- $I_{CLP>>>}$ Activation time ($t_{CLP>>>}$) 0.00...100.0 s
- I>>> Reset time delay ($t_{>>>RES}$) 0.00...100.0 s

Definite time

- 50/51 Third threshold definite time (I>>>def) 0.100...40.0 I_n
- I>>>def within CLP ($I_{CLP>>>def}$) 0.100...40.0 I_n
- I>>>def Operating time ($t_{>>>def}$) 0.03...10.00 s

Residual overcurrent - 50N/51N

I_{E>} Element

- I_{E>} Curve type (I_{E>}Curve) DEFINITE
IEC/BS A, B, C, ANSI/IEEE MI, VI, EI, EM
- I_{ECLP>} Activation time ($t_{ECLP>}$) 0.00...100.0 s
- I_{E>} Reset time delay ($t_{E>RES}$) 0.00...100.0 s

Definite time

- 50N/51N First threshold definite time (I_{E>}def) 0.002...10.00 I_{En}
- I_{E>}def within CLP ($I_{ECLP>def}$) 0.002...10.00 I_{En}
- I_{E>}def Operating time ($t_{E>def}$) 0.04...200 s

Inverse time

- 50N/51N First threshold inverse time (I_{E>}inv) 0.002...2.00 I_{En}
- I_{E>}inv within CLP ($I_{ECLP>inv}$) 0.002...2.00 I_{En}
- I_{E>}inv Operating time ($t_{E>inv}$) 0.02...60.0 s

I_{E>>} Element

- I_{ECLP>>} Activation time ($t_{ECLP>>}$) 0.00...100.0 s
- I_{E>>} Reset time delay ($t_{E>>RES}$) 0.00...100.0 s

Definite time

- 50N/51N Second threshold definite time (I_{E>>}def) 0.002...10.00 I_{En}
- I_{E>>}def within CLP ($I_{ECLP>>def}$) 0.02...10.00 I_{En}
- I_{E>>}def Operating time ($t_{E>>def}$) 0.03...10.00 s

I_{E>>>} Element

- I_{ECLP>>>} Activation time ($t_{ECLP>>>}$) 0.00...100.0 s
- I_{E>>>} Reset time delay ($t_{E>>>RES}$) 0.00...100.0 s

Definite time

- 50N/51N Third threshold definite time (I_{E>>>}def) 0.002...10.00 I_{En}
- I_{E>>>}def within CLP ($I_{ECLP>>>def}$) 0.002...10.00 I_{En}
- I_{E>>>}def Operating time ($t_{E>>>def}$) 0.03...10.00 s

Residual overvoltage - 59N

Common configuration:

- 59N Operating mode from 74VT external (74VText59N) OFF/Block

U_{E>} Element

- U_{E>} Curve type (U_{E>}Curve) DEFINITE, INVERSE
- U_{E>} Reset time delay ($t_{UE>RES}$) 0.00...100.0 s

Definite time

- 59N First threshold definite time (U_{E>}def) 0.01...0.70 U_{En}
- U_{E>}def Operating time ($t_{UE>def}$) 0.07...100.0 s

Inverse time

- 59N First threshold inverse time (U_{E>}inv) 0.01...0.50 U_{En}
- U_{E>}inv Operating time ($t_{UE>inv}$) 0.10...100.0 s

U_{E>>} Element

- U_{E>>} Reset time delay ($t_{UE>>RES}$) 0.00...100.0 s
- 59N Second threshold definite time (U_{E>>}def) 0.01...0.70 U_{En}
- U_{E>>}def Operating time ($t_{UE>>def}$) 0.07...100.0 s

Note [1] - The mathematical formula for INVERSE curves is:

$$t = 0.5 \cdot t_{UE>inv} / [(U_E/U_{E>inv}) - 1]$$

where:

t = trip time (in seconds)

$t_{UE>inv}$ = operating time setting (in seconds)

U_E = residual input voltage

$U_{E>inv}$ = threshold setting

Directional earth fault overcurrent - 67N

Common configuration:

- 67N Operating mode (Mode67N) $||I \cdot \cos$
- 67N Multiplier of threshold for insensitive zone (M) 1.5...10.0
- 67N Operating mode from 74VT external (74VText67N) OFF/Block/Not directional

I_{ED>} Element

- I_{ED>} Curve type DEFINITE
IEC/BS A, B, C, ANSI/IEEE MI, VI, EI, EM
- I_{EDCLP>} Activation time ($t_{EDCLP>}$) 0.00...100.0 s
- I_{ED>} Reset time delay ($t_{ED>RES}$) 0.00...100.0 s

Definite time

67N First threshold definite time (I_{ED>}def - U_{ED>}def)

- Residual current pickup value 0.002...10.00 I_{En}
- Residual voltage pickup value 0.004...0.500 U_{En}
- Characteristic angle 0...359°
- Half operating sector 1...180°
- I_{ED>}def within CLP ($I_{EDCLP>def}$) 0.002...10.00 I_{En}
- I_{ED>}def Operating time ($t_{ED>def}$) 0.05...200 s

Inverse time

67N First threshold inverse time ($I_{ED>inv} - U_{ED>inv}$)

- Residual current pickup value 0.002...2.00 I_{En}
- Residual voltage pickup value 0.004...0.500 U_{En}
- Characteristic angle 0...359°
- Half operating sector 1...180°
- $I_{ED>inv}$ within CLP ($I_{EDCLP>inv}$) 0.002...2.00 I_{En}
- $I_{ED>inv}$ Operating time ($t_{ED>inv}$) 0.02...60.0 s

$I_{ED>>}$ Element

- $I_{ED>>}$ Curve type ($I_{ED>>}Curve$) DEFINITE
IEC/BS A, B, C, ANSI/IEEE MI, VI, EI, EM
- $I_{EDCLP>>}$ Activation time ($t_{EDCLP>>}$) 0.00...100.0 s
- $I_{ED>>}$ Reset time delay ($t_{ED>>RES}$) 0.00...100.0 s

Definite time

67N Second threshold definite time ($I_{ED>>def} - U_{ED>>def}$)

- Residual current pickup value 0.002...10.00 I_{En}
- Residual voltage pickup value 0.004...0.500 U_{En}
- Characteristic angle 0...359°
- Half operating sector 1...180°
- $I_{ED>>def}$ within CLP ($I_{EDCLP>>def}$) 0.002...10.00 I_{En}
- $I_{ED>>def}$ Operating time ($t_{ED>>def}$) 0.05...10.00 s

Inverse time

67N Second threshold inverse time ($I_{ED>>inv} - U_{ED>>inv}$)

- Residual current pickup value 0.002...2.00 I_{En}
- Residual voltage pickup value 0.004...0.500 U_{En}
- Characteristic angle 0...359°
- Half operating sector 1...180°
- $I_{ED>inv}$ within CLP ($I_{EDCLP>>inv}$) 0.002...2.00 I_{En}
- $I_{ED>inv}$ Operating time ($t_{ED>>inv}$) 0.02...10.00 s

$I_{ED>>>}$ Element

- $I_{EDCLP>>>}$ Activation time ($t_{EDCLP>>>}$) 0.00...100.0 s
- $I_{ED>>>}$ Reset time delay ($t_{ED>>>RES}$) 0.00...100.0 s

Definite time

67N Third threshold definite time ($I_{ED>>>def} - U_{ED>>>def}$)

- Residual current pickup value 0.002...10.00 I_{En}
- Residual voltage pickup value 0.004...0.500 U_{En}
- Characteristic angle 0...359°
- Half operating sector 1...180°
- $I_{ED>>>def}$ within CLP ($I_{EDCLP>>>def}$) 0.002...10.00 I_{En}
- $I_{ED>>>def}$ Operating time ($t_{ED>>>def}$) 0.05...10.00 s

$I_{ED>>>>}$ Element

- $I_{EDCLP>>>>}$ Activation time ($t_{EDCLP>>>>}$) 0.00...100.0 s
- $I_{ED>>>>}$ Reset time delay ($t_{ED>>>>RES}$) 0.00...100.0 s

Definite time

67N Fourth threshold definite time ($I_{ED>>>>def} - U_{ED>>>>def}$)

- Residual current pickup value 0.002...10.00 I_{En}
- Residual voltage pickup value 0.004...0.500 U_{En}
- Characteristic angle 0...359°
- Half operating sector 1...180°
- $I_{ED>>>>def}$ within CLP ($I_{EDCLP>>>>def}$) 0.002...10.00 I_{En}
- $I_{ED>>>>def}$ Operating time ($t_{ED>>>>def}$) 0.05...10.00 s

Selective block - BLOCK2

Selective block IN:

- BLIN Max activation time for phase protections (t_{B-IPh}) 0.10...10.00 s
- BLIN Max activation time for earth protections (t_{B-IE}) 0.10...10.00 s

Selective block OUT:

- BLOUT Dropout time delay for phase protections (t_{F-IPh}) 0.00...1.00 s
- BLOUT Drop-out time delay for ground protections (t_{F-IE}) 0.00...1.00 s
- BLOUT Drop-out time delay for phase and ground protections ($t_{F-IPh/IE}$) 0.00...1.00 s

Internal selective block - BLOCK4

- Output internal selective block dropout time for phase protections (t_{F-IPh}) 0.00...10.00 s
- Output internal selective block dropout time for ground protections (t_{F-IE}) 0.00...10.00 s

Breaker failure - BF

- BF Phase current threshold ($I_{BF>}$) 0.05...1.00 I_n
- BF Residual current threshold ($I_{EBF>}$) 0.01...2.00 I_{En}
- BF Time delay (t_{BF}) 0.06...10.00 s

Second Harmonic Restraint - 2ndh-REST

- Second harmonic restraint threshold ($I_{2ndh>}$) 10...50 %
- $I_{2ndh>}$ Reset time delay ($t_{2ndh>RES}$) 0.00...100.0 s

CT supervision - 74CT

- 74CT Threshold ($S<$) 0.10...0.95
- 74CT Overcurrent threshold (I^*) 0.10...1.00 I_n
- $S<$ Operating time ($t_{S<}$) 0.03...200 s

Circuit Breaker supervision

- Number of CB trips (N_{Open}) 0...10000
- Cumulative CB tripping currents ($SumI$) 0...5000 I_n
- CB opening time for I^2t calculation (t_{break}) 0.05...1.00 s
- Cumulative CB tripping I^2t ($SumI^2t$) 0...5000 $I_n^2 \cdot s$
- CB max allowed opening time ($t_{break>}$) 0.05...1.00 s

CT supervision - 74CT

- 74CT Threshold ($S<$) 0.10...0.95
- 74CT Overcurrent threshold (I^*) 0.10...1.00 I_n
- $S<$ Operating time ($t_{S<}$) 0.03...200 s

Pilot wire diagnostic

- BLOUT1 Diagnostic pulses period ($PulseBLOUT1$) OFF - 0.1-1-5-10-60-120 s
- BLIN1 Diagnostic pulses control time interval ($PulseBLIN1$) OFF - 0.1-1-5-10-60-120 s

METERING & RECORDING

Measured parameters

Direct:

- Frequency f
- Fundamental RMS phase currents I_{L1}, I_{L2}, I_{L3}
- Fundamental RMS residual current I_E
- Fundamental RMS residual voltage U_E

Calculated:

- Thermal image DTheta
- Maximum current between $I_{L1}-I_{L2}-I_{L3}$ I_{Lmax}
- Minimum current between $I_{L1}-I_{L2}-I_{L3}$ I_{Lmin}
- Average current between $I_{L1}-I_{L2}-I_{L3}$ I_L

Phase:

- Displacement angle of U_E respect to I_E $PhiE$

Sequence:

- Positive sequence current I_1
- Negative sequence current I_2
- Negative sequence current/positive sequence current ratio I_2/I_1

Harmonics:

- Second harmonic phase currents $I_{L1-2nd}, I_{L2-2nd}, I_{L3-2nd}$
- Maximum of the second harmonic phase currents/fundamental component percentage ratio I_{-2nd}/I_L
- Third harmonic phase currents $I_{L1-3rd}, I_{L2-3rd}, I_{L3-3rd}$
- Third harmonic residual current I_{E-3rd}
- Third harmonic residual voltage U_{E-3rd}
- Fourth harmonic phase currents $I_{L1-4th}, I_{L2-4th}, I_{L3-4th}$
- Fifth harmonic phase currents $I_{L1-5th}, I_{L2-5th}, I_{L3-5th}$

Demand phase currents:

- Phase fixed currents demand $I_{L1FIX}, I_{L2FIX}, I_{L3FIX}$
- Phase rolling currents demand $I_{L1ROL}, I_{L2ROL}, I_{L3ROL}$
- Phase peak currents demand $I_{L1MAX}, I_{L2MAX}, I_{L3MAX}$
- Phase minimum currents demand $I_{L1MIN}, I_{L2MIN}, I_{L3MIN}$

Event recording (SER)

- Number of events 300
- Recording mode circular

Trigger:

- Output relays switching K1...K6...Kx
- Binary inputs switching IN1...IN5...INx

Setting changes

Data recorded:

- Event counter (resettable by ThySetter) 0...10⁹
- Event cause binary input/output relay/setting changes
- Time stamp Date and time

Fault recording (SFR)


Number of faults	20
Recording mode	circular
Trigger:	
• External trigger (binary inputs)	IN1...IN5...INx
• Element pickup (OFF-ON transition)	Start/Trip
Data recorded:	
• Time stamp	Date and time
• Fault cause	start, trip, binary input
• Fault counter (resettable by ThySetter)	0...10 ⁹
• Fundamental RMS phase and residual currents	$I_{L1r}, I_{L2r}, I_{L3r}, I_{Er}$
• Fundamental RMS residual voltage	U_{Er}
• Displacement angle ($U_{Er}-I_{Er}$)	Phi_{Er}
• Thermal image	$D\Theta_{theta-r}$
• Binary inputs and outputs state	IN1...IN5...INx, K1...K6...K10
• Fault cause info (operating phase)	L1, L2, L3
Settings recording	
Number of setting changes	8
Recording mode	circular
Data recorded:	
• Setting counter	0...10 ⁹
• Setting data	description and parameter
• Time stamp	Date and time

Digital Fault Recorder (Oscillography)

File format	COMTRADE
Records	depending on setting ^[1]
Recording mode	circular
Sampling rate	>1 kHz
Trigger setup:	
• Pre-trigger time	0.05...1.00 s
• Post-trigger time	0.05...60.00 s
• Trigger from inputs and outputs	IN1...IN5...INx, K1...K6...K10
• Communication	ThySetter
Set sample channels:	
• Instantaneous currents and residual voltage	$i_{L1}, i_{L2}, i_{L3}, i_E, u_E$
Set analog channels (Analog 1...12):	
• Frequency	f
• Fundamental RMS phase and residual currents	$I_{L1}, I_{L2}, I_{L3}, I_E$
• Fundamental RMS residual voltage	U_E
• Displacement angle (U_E-I_E)	Phi_E
• Second harmonic phase currents	$I_{L1-2nd}, I_{L2-2nd}, I_{L3-2nd}$
• Maximum of the second harmonic phase currents/fundamental component percentage ratio	I_{-2nd} / I_L
Set digital channels (Digital 1...12):	
• Binary inputs and output relays state	IN1...INx, K1...K6...K10


Note [1] - For instance, with following setting:

- Pre-trigger and post-trigger time 0.25 s
- Sampled channels $i_{L1}, i_{L2}, i_{L3}, i_E$
- Analog channels $I_{L1}, I_{L2}, I_{L3}, I_E$
- Digital channels K1, K2, K3, K4, K5, K6, IN1...IN5
- More than three hundred records can be stored

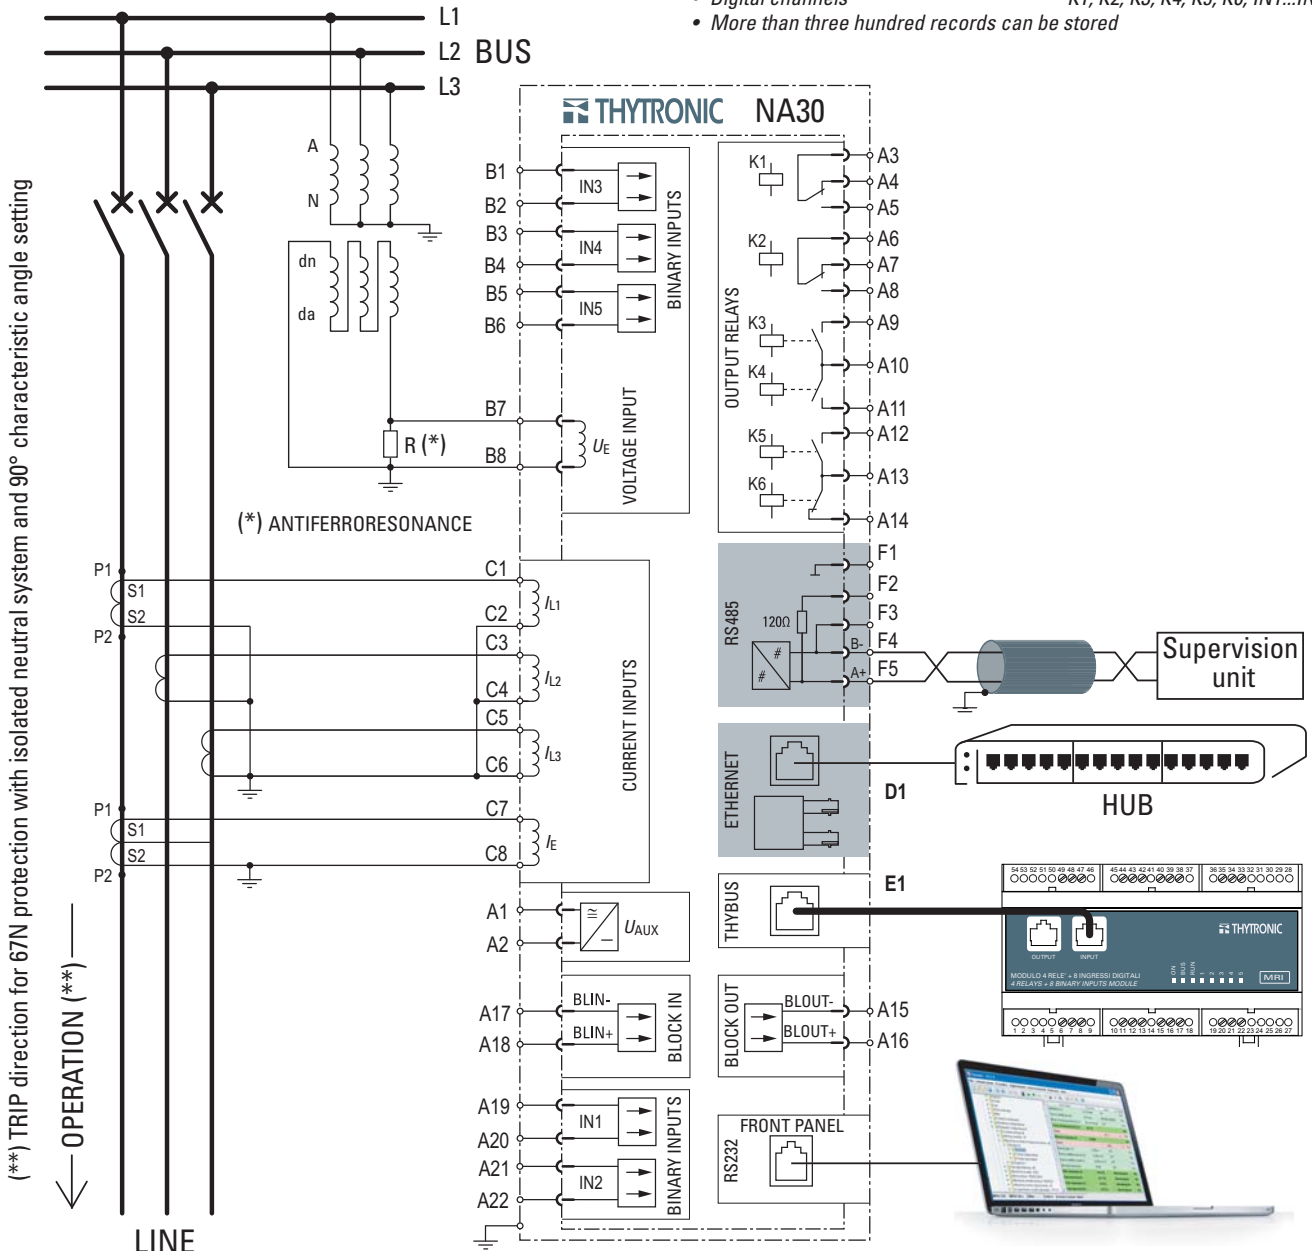


DIMENSIONS

FRONT VIEW

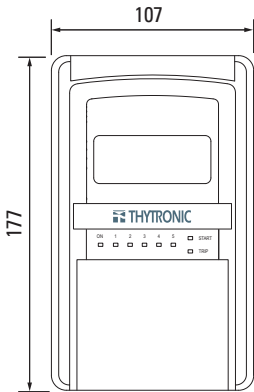


FLUSH MOUNTING

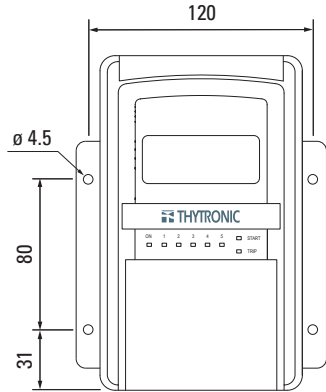


PROJECTING MOUNTING

REAR VIEW

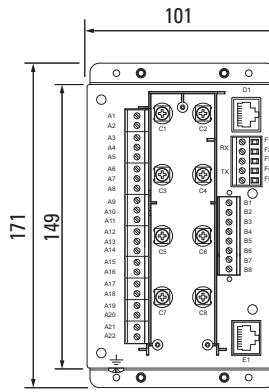


FLUSH MOUNTING

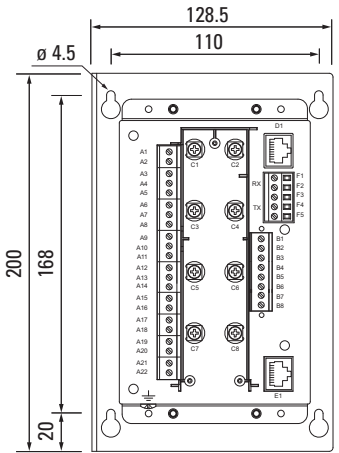


PROJECTING MOUNTING
(Separate operator panel)

SIDE VIEW

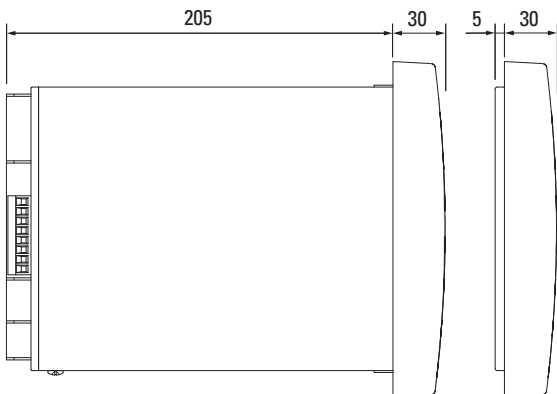


FLUSH MOUNTING

SEPARATE
OPERATOR PANEL

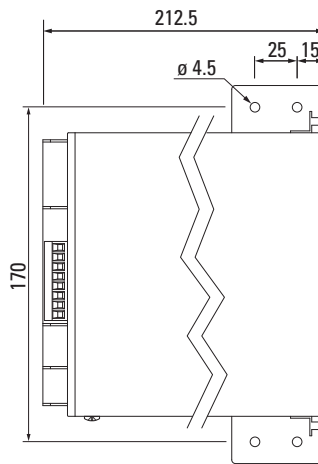


PROJECTING MOUNTING
(Separate operator panel)

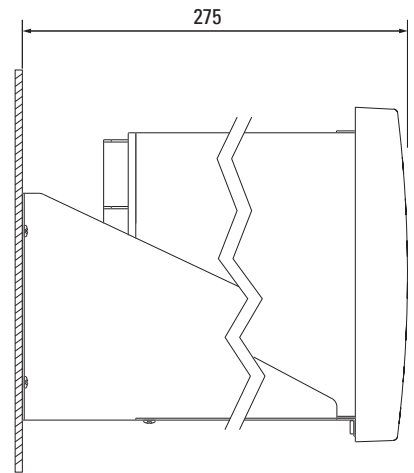

PROJECTING MOUNTING
(Stand alone)

RACK MOUNTING

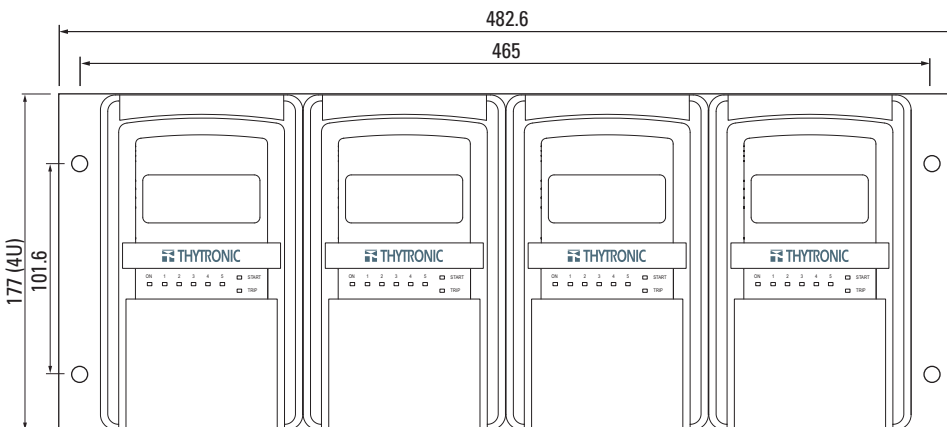

FLUSH MOUNTING CUTOUT

